


TYPE I PIPE BEDDING

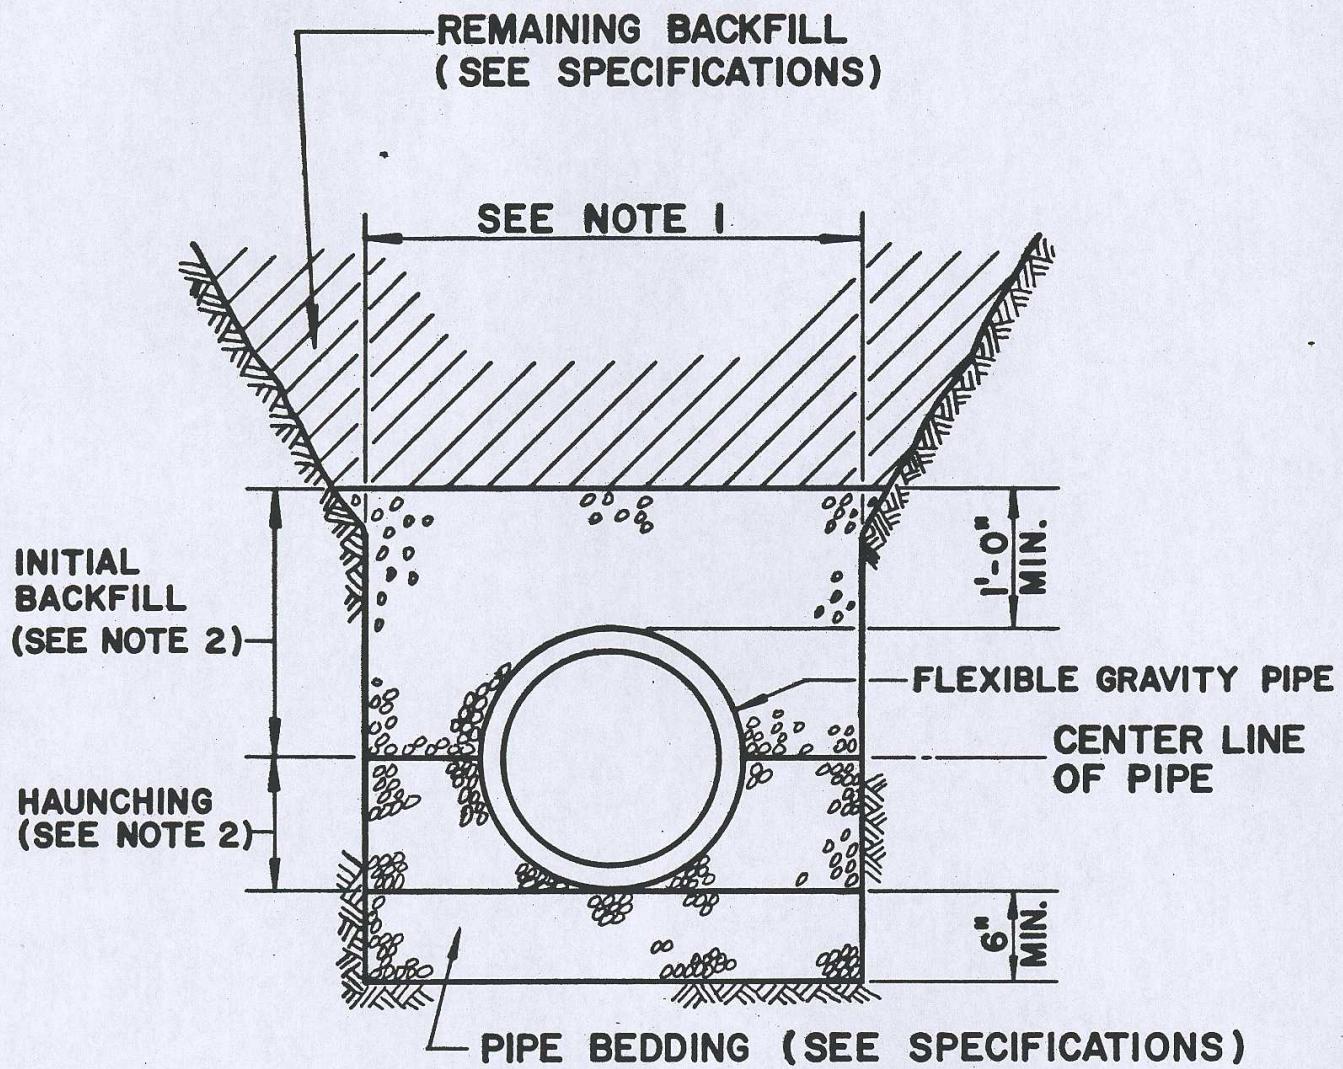

TYPICAL TRENCH CROSS-SECTION

N. T. S.

NOTES:

1. FOR TRENCH WIDTH SEE SPECIFICATIONS.
2. HAUNCHING AND INITIAL BACKFILL SHALL BE LIGHTLY COMPACTED, WELL GRADED CLEAN GRAVEL OR CRUSHED STONE WITH MAXIMUM SIZE OF 3/4", 95% PASSING 1/2" SIEVE AND NOT MORE THAN 5% PASSING NO. 4 SIEVE.