


TYPE II PIPE BEDDING

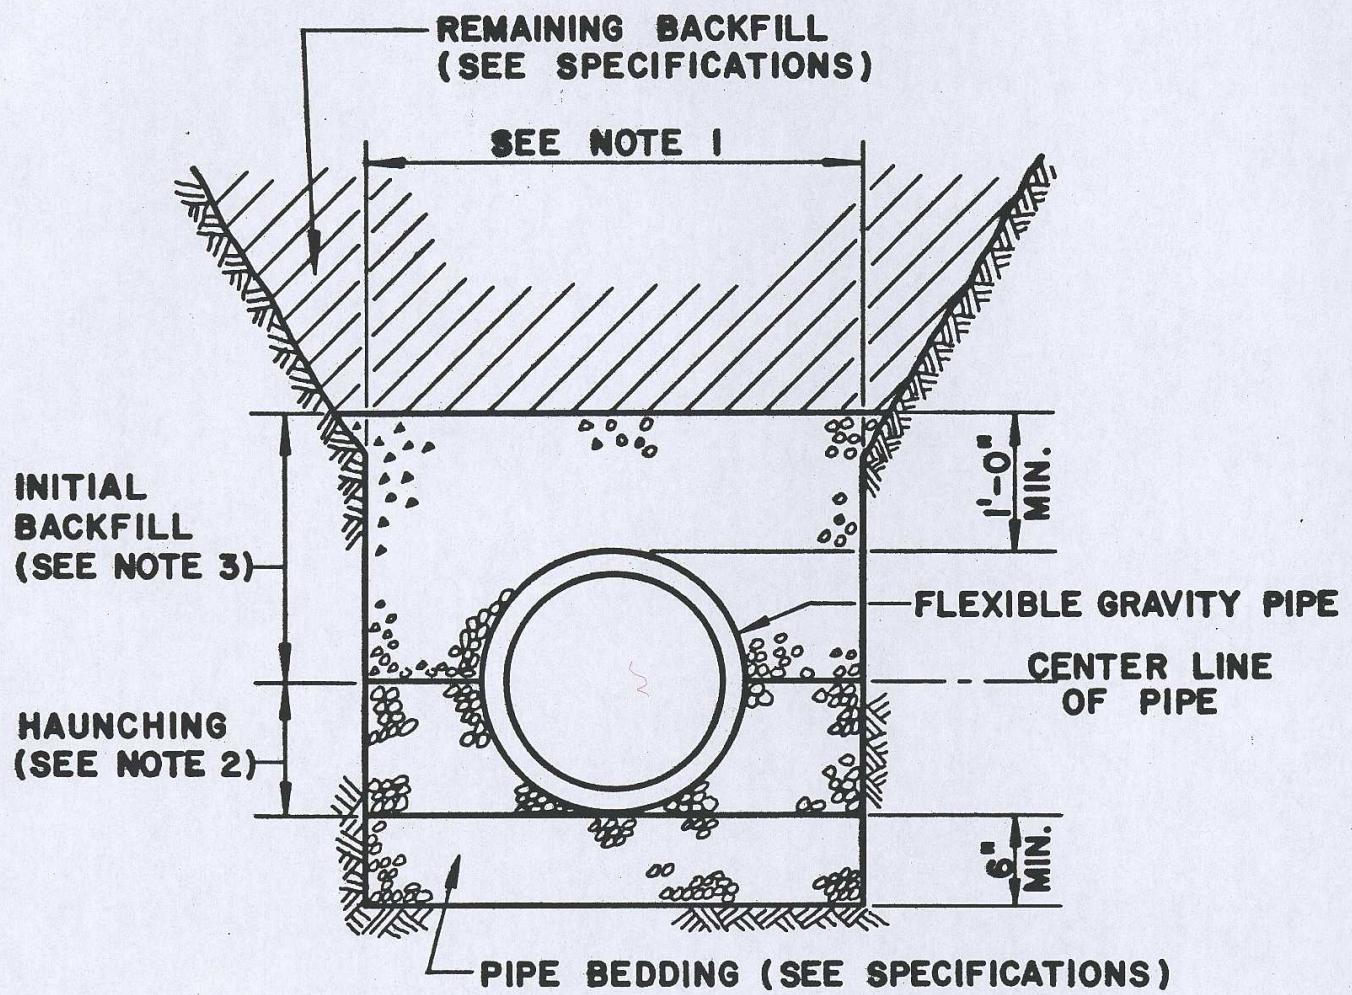

TYPICAL TRENCH CROSS-SECTION

N. T. S.

NOTES:

1. FOR TRENCH WIDTH SEE SPECIFICATIONS.
2. HAUNCHING SHALL BE GRADED COARSE SAND AND GRAVELS, GRANULAR AND NON-COHESIVE WITH MAXIMUM SIZE OF $3/4"$ AND NOT MORE THAN 5% PASSING NO. 200 SIEVE, COMPACT TO 80% MAXIMUM DENSITY ASTM D-1557.
3. INITIAL BACKFILL SHALL BE EITHER SAME MATERIAL AS HAUNCHING; FINE SAND, OR FINELY DIVIDED JOB EXCAVATED, SAND-CLAY OR GRAVEL-CLAY MIXTURE WITH MAXIMUM SIZE OF $3/4"$. COMPACT TO 80% MAXIMUM DENSITY, ASTM D-1557 IF SAME MATERIAL AS HAUNCHING; COMPACT TO 85% IF ANY OTHER MATERIAL.