


CLASS "B" PIPE BEDDING

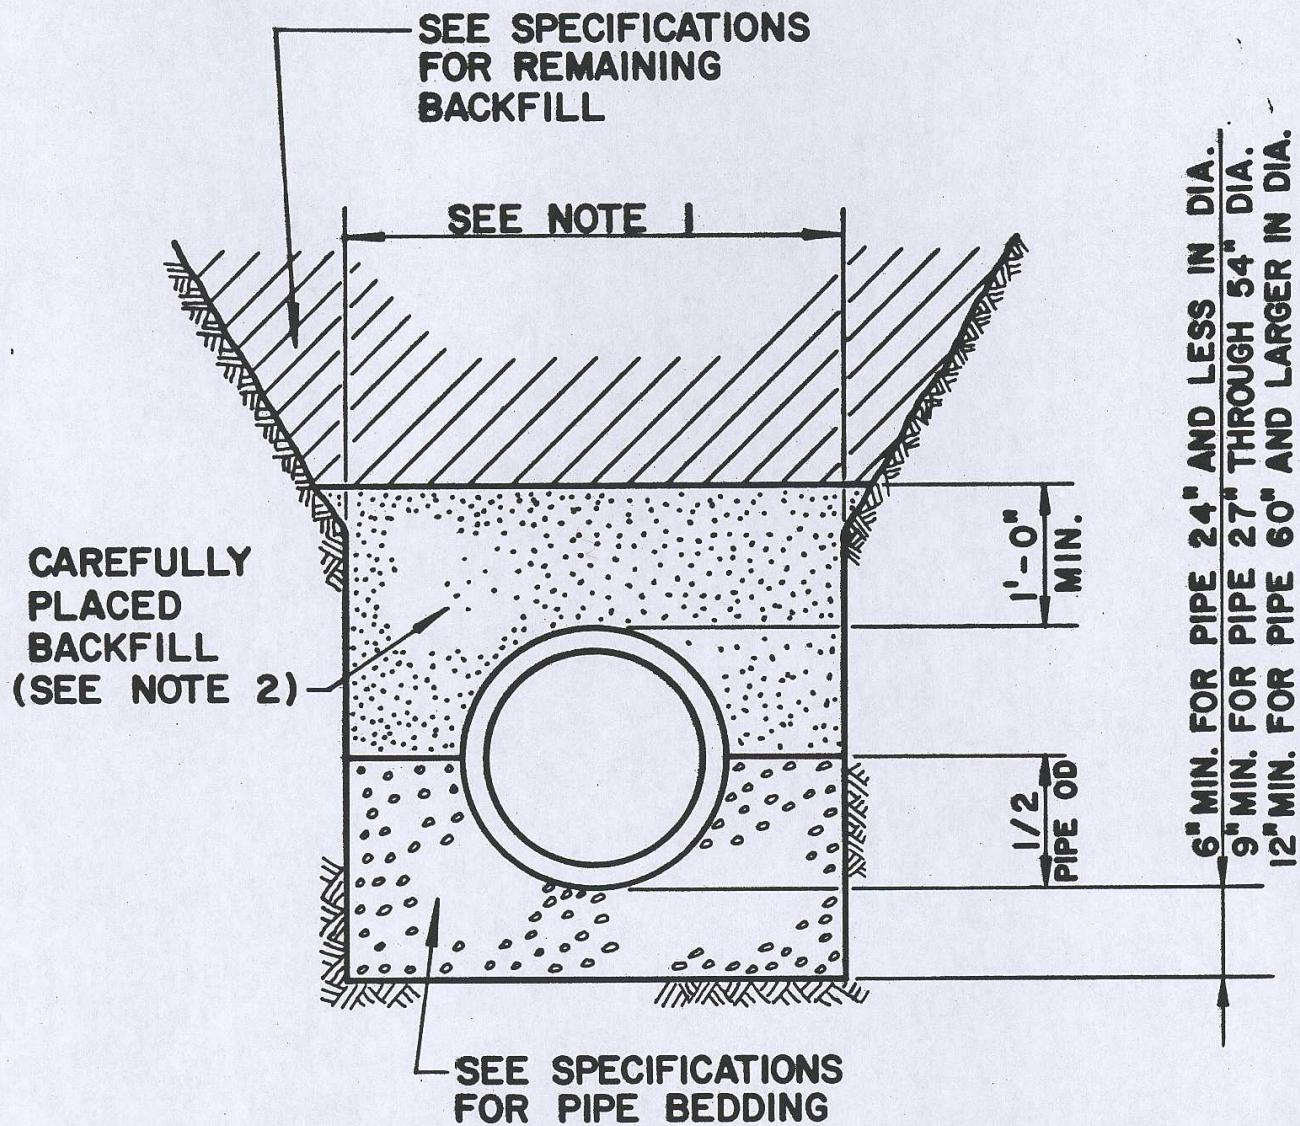

TYPICAL TRENCH CROSS-SECTION

N. T. S.

NOTES:

1. FOR ALLOWABLE TRENCH WIDTH SEE SPECIFICATIONS.
2. CAREFULLY PLACED BACKFILL SHALL BE CAREFULLY COMPACTED, FINELY DIVIDED, JOB EXCAVATED MATERIAL, FREE FROM DEBRIS, STONES, ORGANIC MATTER AND FROZEN MATERIAL, COMPACTED TO 90% MAXIMUM DENSITY, ASTM D1557. GRANULAR FILL MAY BE SUBSTITUTED FOR JOB EXCAVATED MATERIAL.