


WATER VALVE VAULT

NEENAH R-1713 FRAME.
THE WORD "WATER" SHALL
BE CAST INTO THE LID

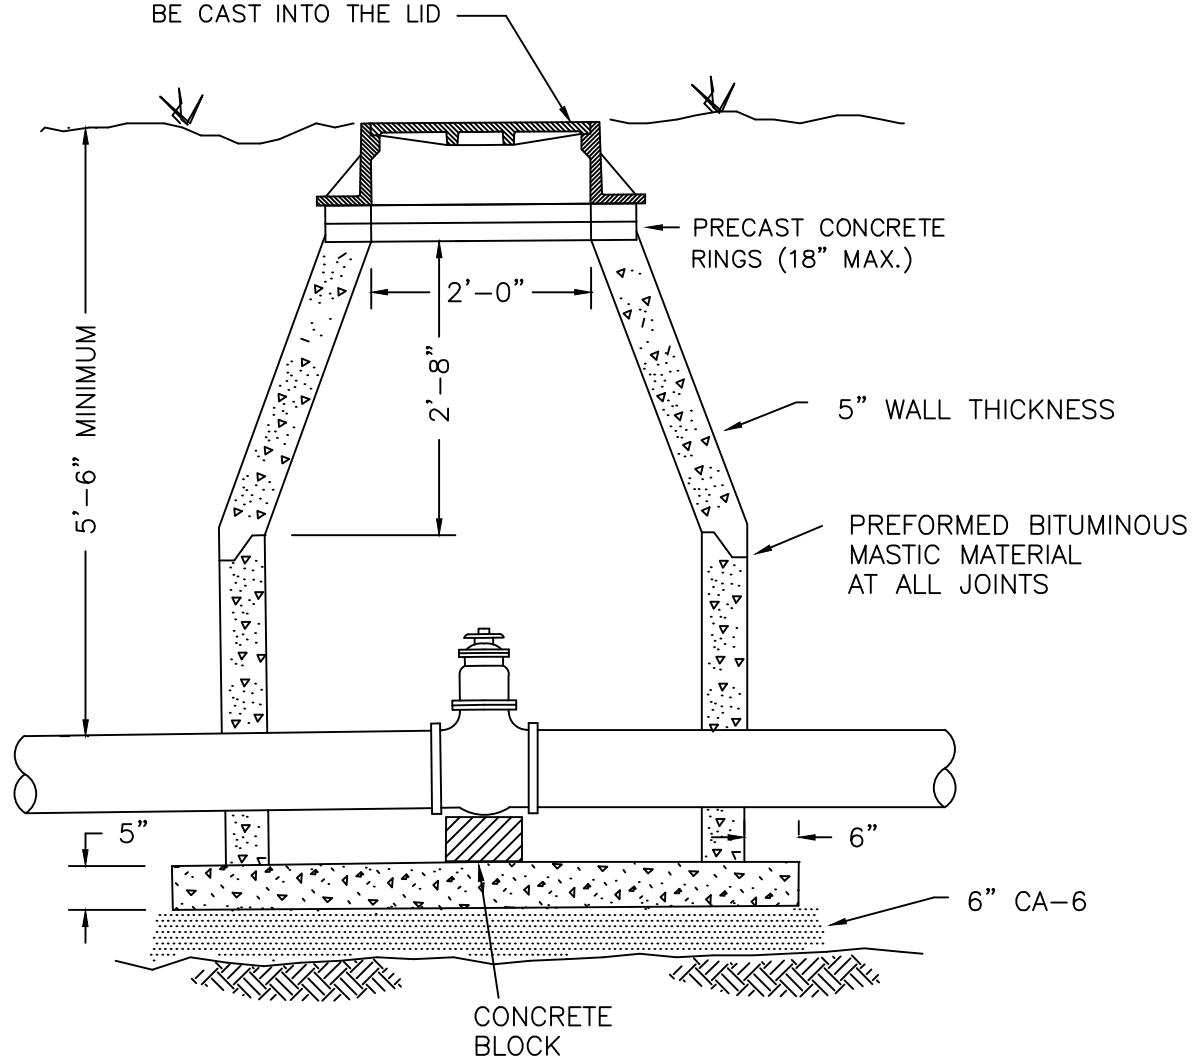

INSIDE DIAMETER SHALL BE 48" FOR WATER MAIN 6" THROUGH 10"
AND 60" FOR WATER MAIN 12" AND OVER AND PRESSURE CONNECTIONS

VALVES SHALL BE RESILIENT WEDGE GATE VALVES CONFORMING
TO AWWA C509 AND SHALL BE MUELLER OR WATEROUS