


WATER SERVICE DISCONNECTION

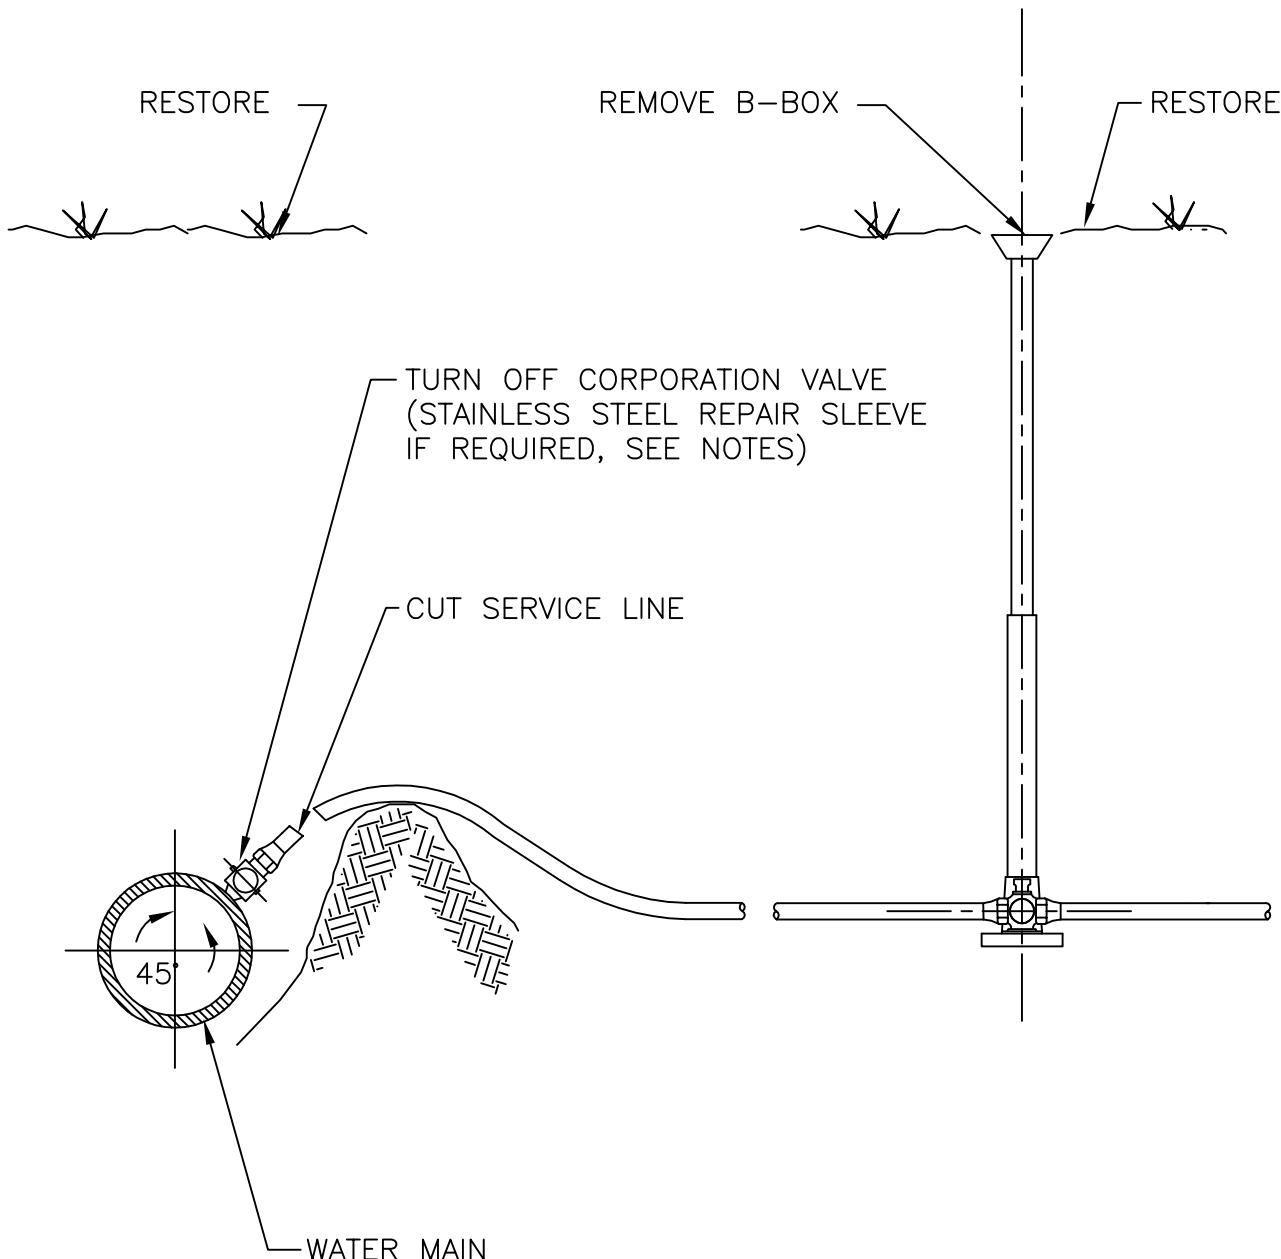

NOTES:

ALL DISTURBED AREAS SHALL BE RESTORED TO ORIGINAL, OR BETTER, CONDITION.

WATER SERVICE DISCONNECTIONS 3/4 AND 1" SHALL BE SHUT OFF AT WATER MAIN IF THE CORPORATION VALVE LEAKS, CORPORATION SHALL BE REMOVED, AND STAINLESS STEEL REPAIR SLEEVE SHALL BE PLACED OVER THE TAP.

WATER SERVICE DISCONNECTIONS GREATER THAN 1": CORPORATION VALVE SHALL BE REMOVED, AND A STAINLESS STEEL REPAIR SLEEVE SHALL BE PLACED OVER THE TAP.

DISCONNECTION INSPECTIONS AND MAIN SHUT DOWNS SHALL BE COORDINATED WITH PUBLIC WORKS UTILITY DIVISION.