


WATER SERVICE DETAIL

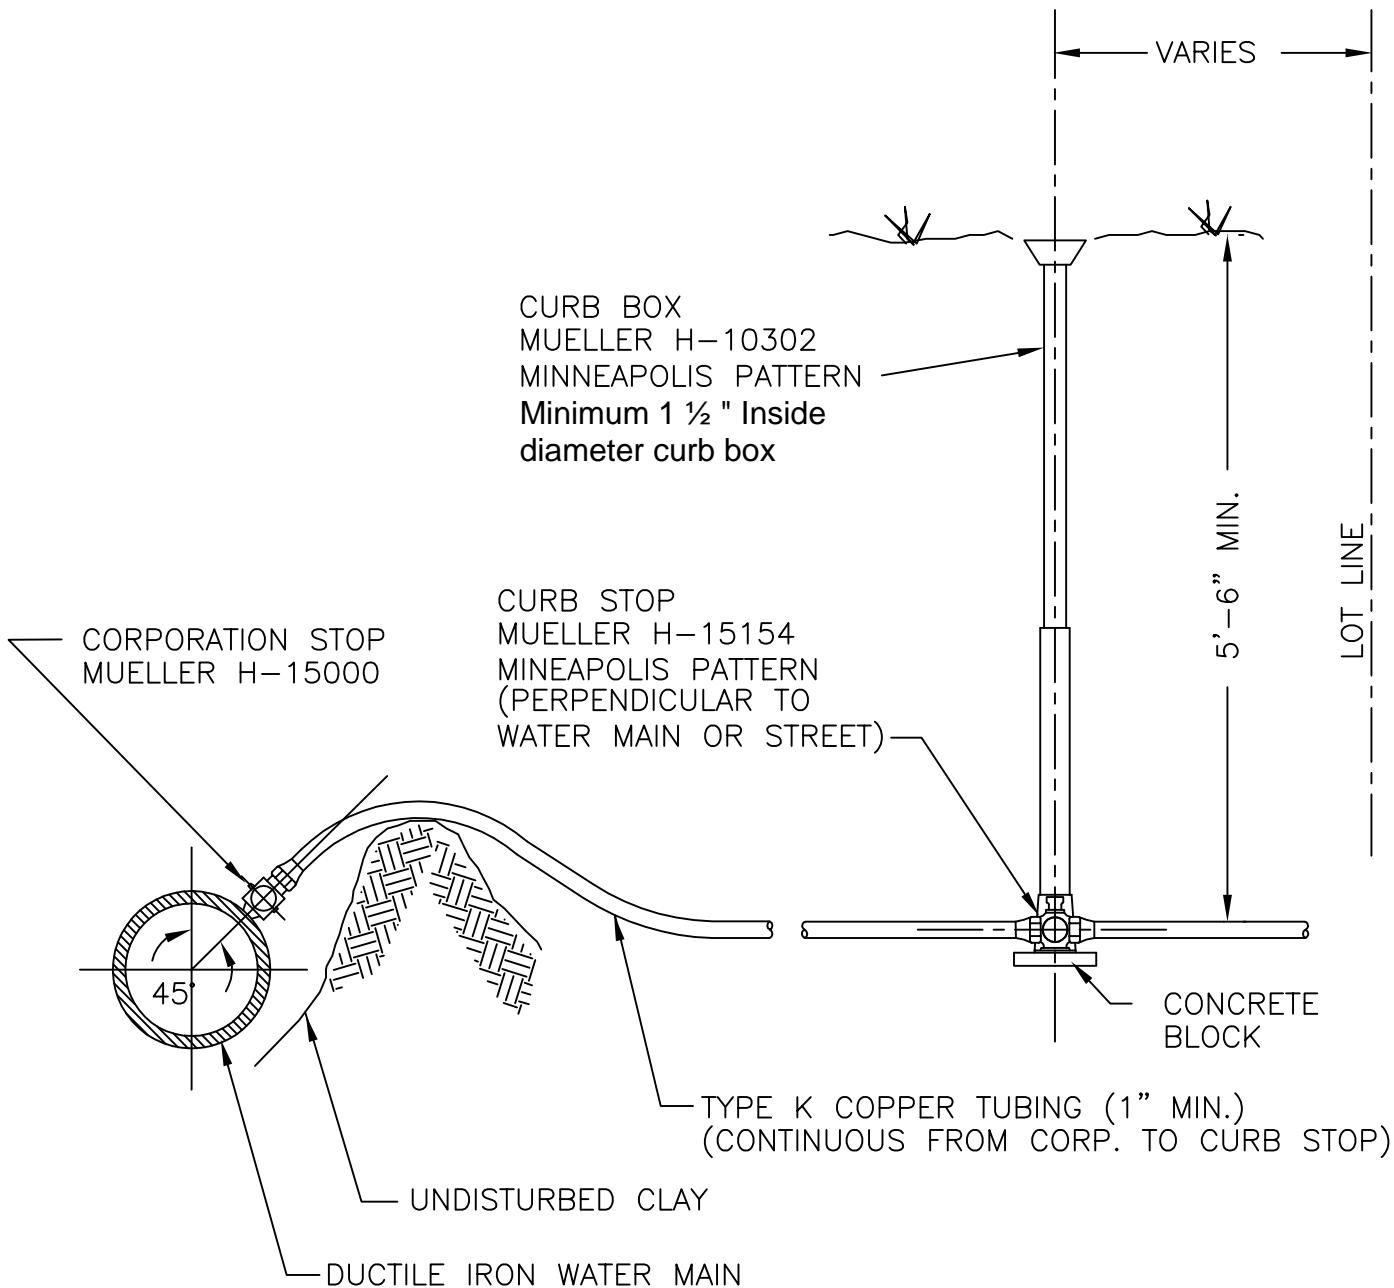

NOTES:

WATER SERVICE LINE SHALL BE IN A SEPARATE TRENCH 10 FT. FROM THE SANITARY SEWER SERVICE LINE OR IN THE SAME TRENCH BUT ON A SHELF 18" ABOVE THE SEWER LINE, IN WHICH CASE THE SEWER PIPE MATERIAL SHALL BE DUCTILE IRON OR SCHEDULE 40 PVC WITH SOLVENT WELD JOINTS.

TAPS TO HDPE WATER MAIN REQUIRE ELECTROFUSION SADDLE
TAPS TO PVC WATER MAIN REQUIRE STAINLESS STEEL TAPPING SLEEVE